

TEST REPORT

Model	PISA1350T-60HZ
Manufacture by	AQUA
Test Category	Hydraulic performance & Compliance Testing

DIRECTIONS

Product: Centrifugal pump

Place of Testing: Aqua Quality Control Center

Temperature: 23 °C RH: 55 %

Power supply: 400V / 3Ph/60Hz


Date: Periodic re-testing is carried out annually in January to verify continued compliance


Name of Equipment	Model	Certificate No.
Intelligent flow speed measuring instrument	SFT-B	2GB24032080205-0158
Three-phase PWM special tester	PF9833	2GB24032080205-0157
Variable frequency power supply	HY8321F	2GB24032080205-0248
Multi-channel temperature tester	TC1008	2GB24032080205-0198
Precision pressure gauge	(-0.1~0.15) MPa	2GB24032080205-0128
Precision pressure gauge	0~0.6 MPa	2GB24032080205-0123
Turbine flow meter	LW-50	1GA24032080205-0119

TEST RESULTS

No	Flow m ³ /h	Head m	Amps	RPM	P1 kW	EFF %	COSφ
1	0.0	26.14	12.61	2977	5.927	0.00	0.71
2	20.0	25.89	13.74	2974	6.935	20.34	0.75
3	40.0	26.40	15.00	2969	7.813	36.83	0.79
4	60.0	26.30	16.47	2966	8.872	48.46	0.82
5	80.0	24.92	17.68	2961	9.709	55.95	0.83
6	100.0	22.78	18.63	2959	10.390	59.73	0.85
7	120.0	20.23	19.62	2956	11.090	59.64	0.86
8	140.0	17.68	20.02	2953	11.360	59.36	0.86
9	150.0	16.30	20.07	2953	11.390	58.49	0.86
10	160.0	14.92	20.14	2953	11.460	56.77	0.86
11	180.0	10.94	19.40	2955	10.970	48.93	0.86
12	193.0	4.31	17.65	2959	9.723	23.33	0.84

H(m)

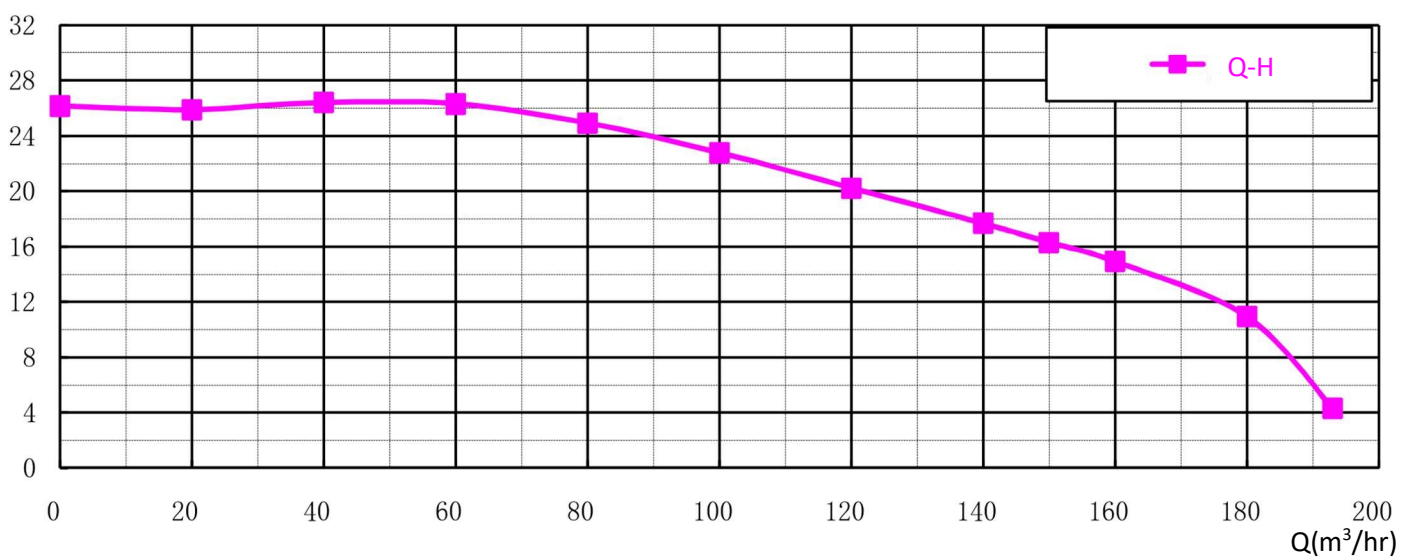

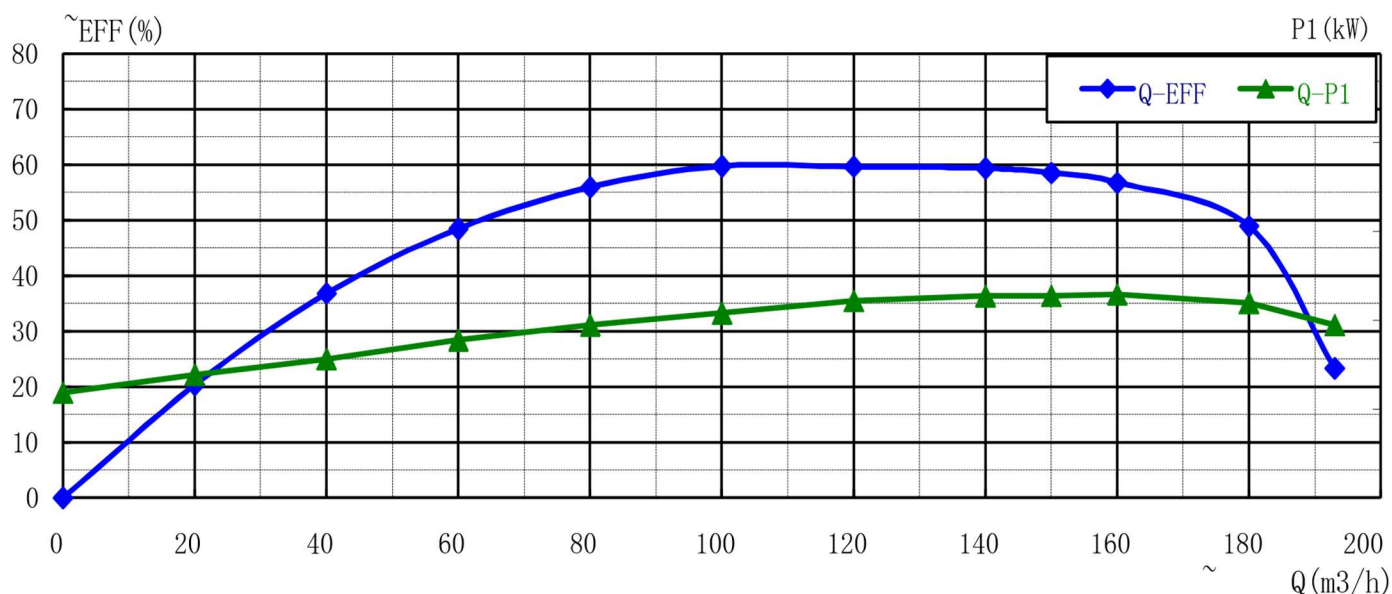

STATEMENTS

1. The results of the testing relate only to the items that tested.
2. The validity of this test report is 12 months.
3. Test report is invalid without the Special Seal of Test Report or that of test unit on it.
4. Test report is invalid without the signature of the chief tester, examiner and approver.
5. Test report is invalid if randomly altered or duplicated.
6. For entrusted tests, this Center is only responsible for the delivered samples.
7. For any claim of the report, refer to the testing unit within 15 days.

Authorized Signature and Company Stamp

AQUA SpA
 Via C. Crotti, 1
 42018 S. Martino in Rio (RE)
 P.I. 02026440350